


1. Method to use if meter cabinet must be mounted free standing.

2. Meter height shall be between 66" and 72" to center of meter.

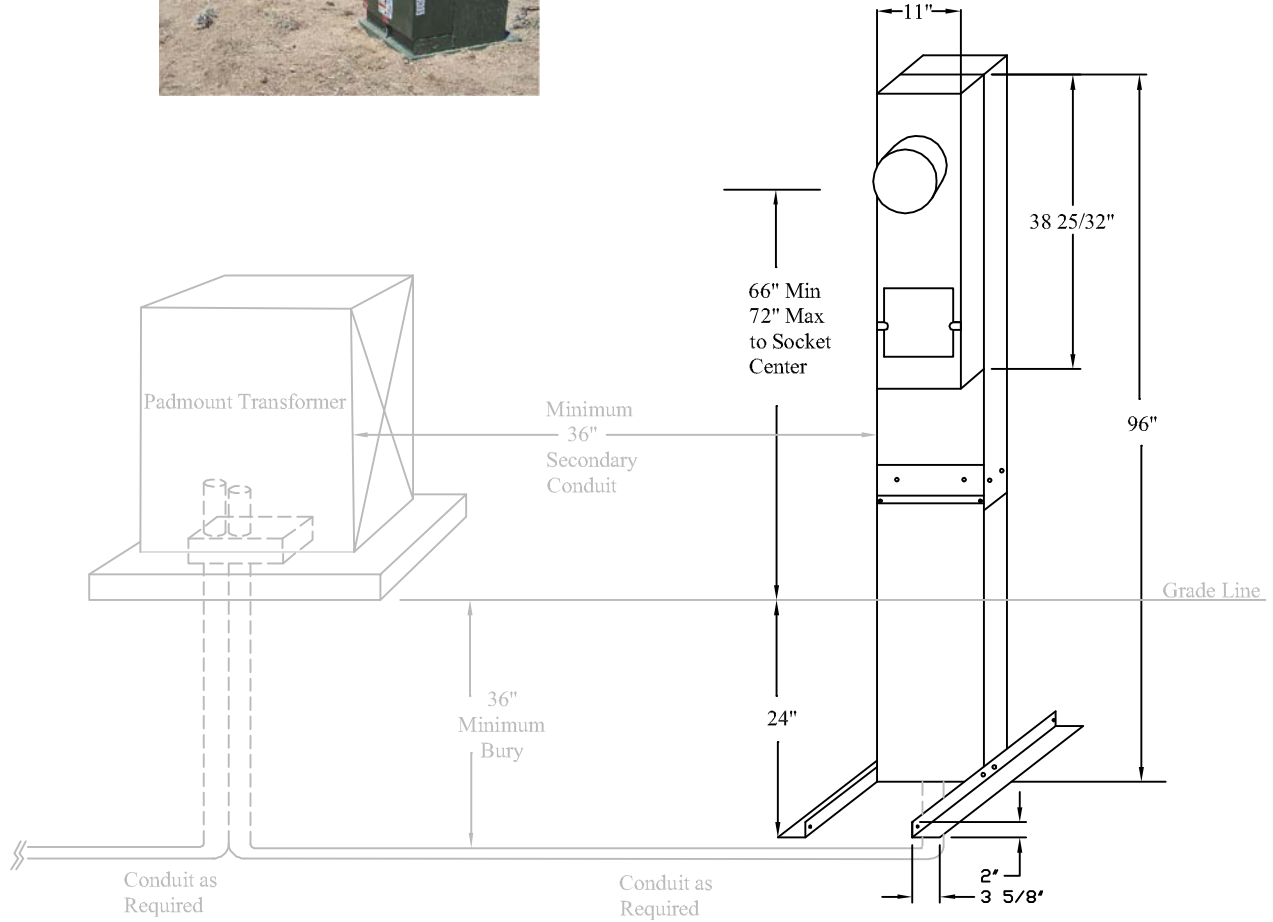

MATERIALS LISTING

ITEM	DESCRIPTION	QTY	UNIT	PREC#
1	Lugs for 350 USE-2			
2	4T 400A (Class 320A) UG Meter Box w/Dual 200A Breakers	1	Ea.	9143
3	Form 2S Class 320 240V 3-Wire 1 Ø Meter	1	Ea.	

Design Parameters:
 > See design notes above.
 >350 USE-2 Cu (350A rating) or 350 URD Al Triplex (415A rating) recommended for secondary cabling.

Underground to Meter Pedestal
 120/240V, 25 kVA , Class 320A 3-Wire UG Service Installation

10/19/09		UM8.4-03SC
Rev. A		