


NOTES:

1. Method for installation of metering to meter socket on building wall.
2. Meter height shall be between 66" and 72" to center of meter.
3. Meter socket must not be attached directly to padmounted transformer.
4. Conduit shall be used for secondary control wires to meter socket, or for mechanical stress relief.

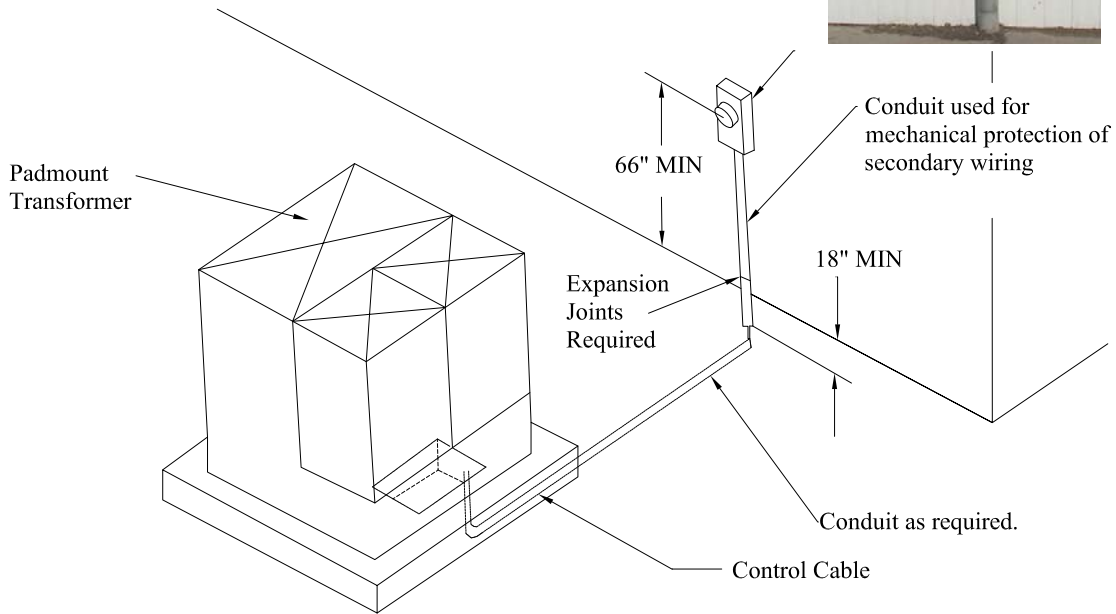

ITEM	PART #	MATERIAL	QTY
1	8245-3	PVC Conduit, Sched 80 - 3"	As Reqd'
2	9160-3	Pipe Strap - 3"	As Reqd'
3	9820-3	PVC Expansion Coupling - 3"	1
4	8116	13T 400/600 Amp Instrument Rated Three Phase Meter Box	1
5		Form 8S/9S Class 400 120 - 480V 4 Wire 3Ø Meter	1

Design Parameters:

1. See design notes above.
2. Recommended Cable: 350 USE-2 Sec. Triplex Al

**120/208V, 400 Amp - 150kVA Bank
4-Wire Instrument Rated Transocket
Underground Secondary Cable to Building
Mounted Meter**

RUS

12/06/2017

REV. A



UM8.7A-04IR