


Penta-head bolt

INSULATED SUBMERSIBLE
CONNECTOR BLOCKS REQUIRED
FOR ALL TERMINALS.
DIVING BELL BOOTS ARE NOT
ACCEPTABLE.

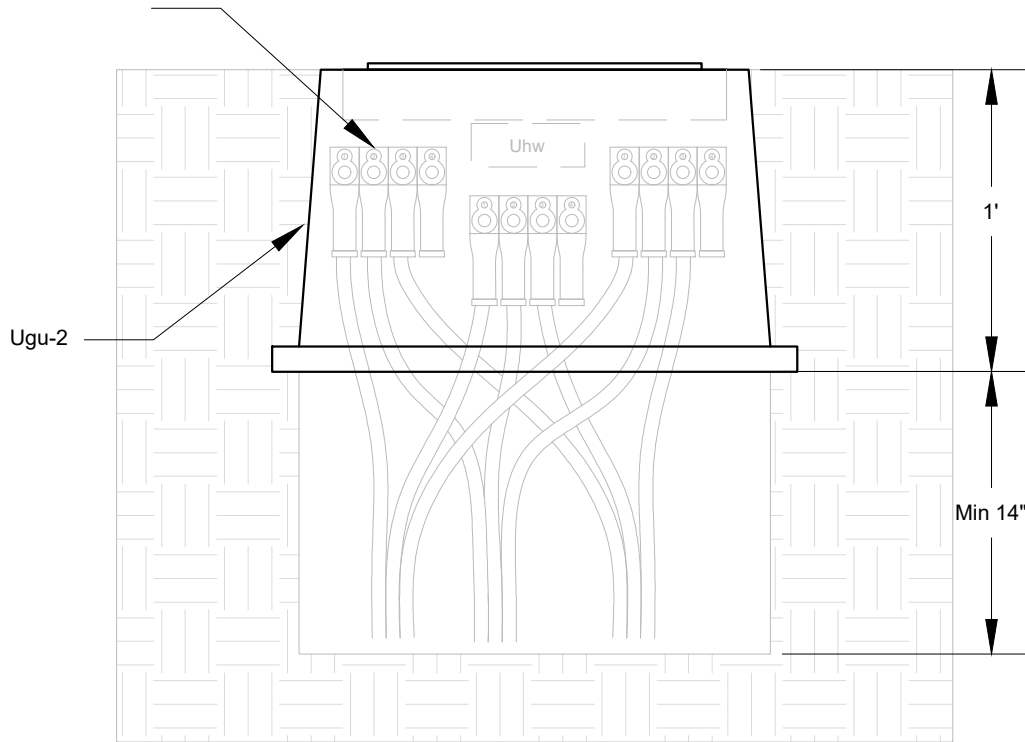

Ugu-2

1'

Min 14"

ITEM	PART #	MATERIAL	QTY
Ugu-2	8191	Secondary Junction Box	1
Uhw		Safety Signs	2

NOTES:

1. PRECORP TO SPECIFY WHETHER UNIT IS TO MOUNTED FLUSH WITH FINAL GRADE OR BURIED. IF BURIED, UNIT SHALL BE A MINIMUM OF 6" BELOW GRADE.
2. ALL JUNCTION BOXES SHALL BE GROUNDED IN ACCORDANCE WITH THE NATIONAL ELECTRICAL SAFETY CODE (NEC).

DESIGN PARAMETERS:

1. For pedestrian traffic only

**SECONDARY HANDHOLE SINGLE-PHASE
GRADE ENCLOSURE**

RUS

1/18/2022

REV. 0



UJ4.1